



UNIVERSITÀ DEGLI STUDI DI MILANO

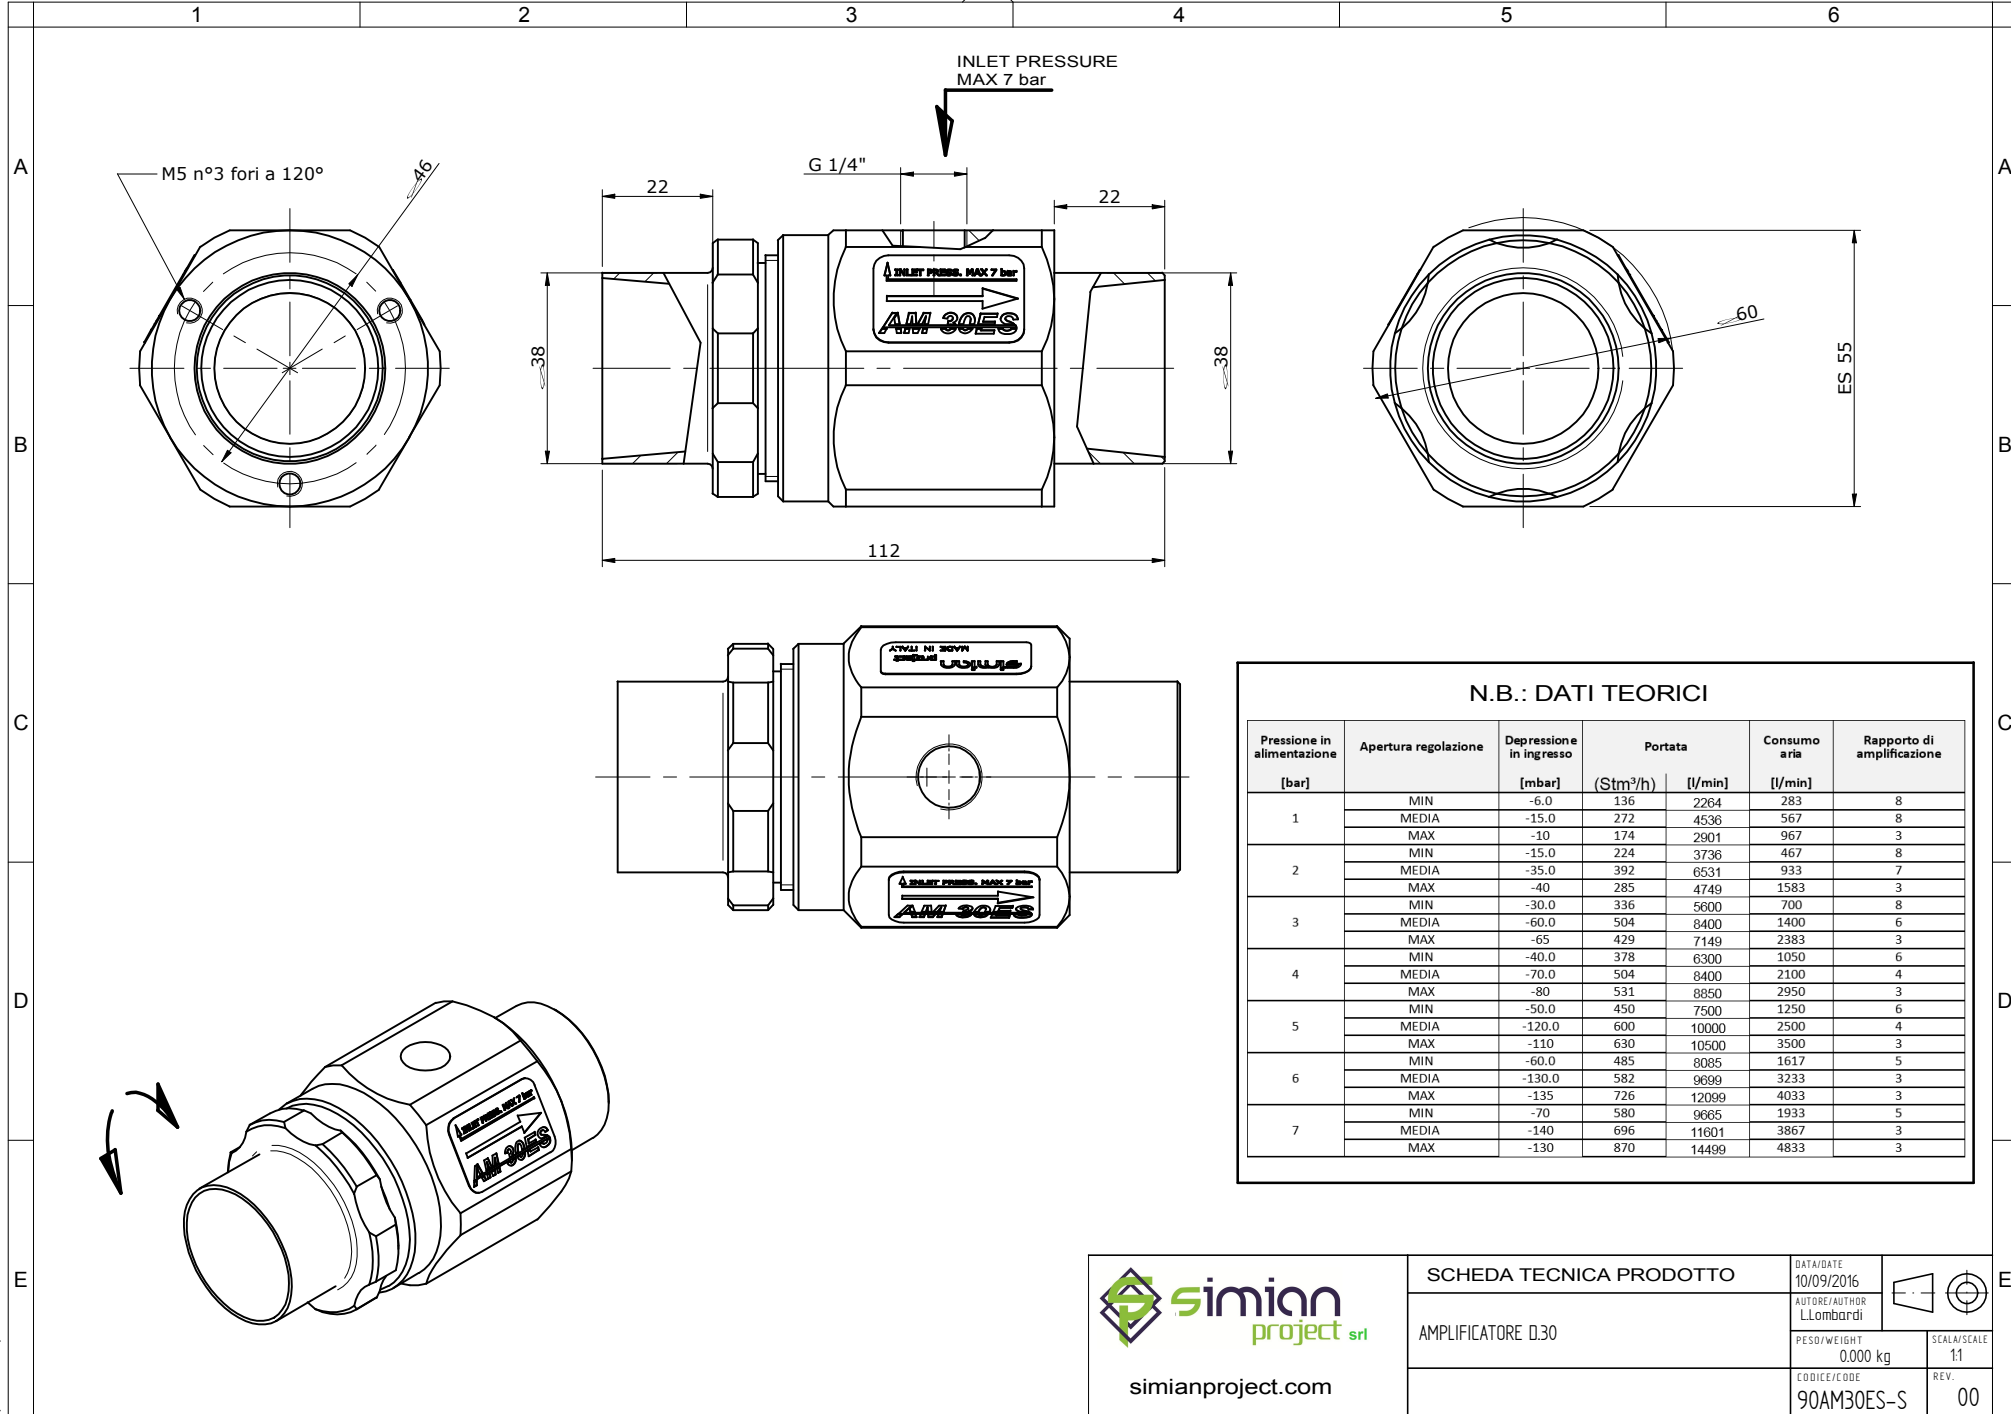

N.B.: DATI TEORICI

Pressione in alimentazione [bar]	Apertura regolazione	Depressione in ingresso [mbar]	Portata		Consumo aria [l/min]	Rapporto di amplificazione
			(Stm³/h)	[l/min]		
1	MIN	-6.0	136	2264	283	8
	MEDIA	-15.0	272	4536	567	8
	MAX	-10	174	2901	967	3
2	MIN	-15.0	224	3736	467	8
	MEDIA	-35.0	392	6531	933	7
	MAX	-40	285	4749	1583	3
3	MIN	-30.0	336	5600	700	8
	MEDIA	-60.0	504	8400	1400	6
	MAX	-65	429	7149	2383	3
4	MIN	-40.0	378	6300	1050	6
	MEDIA	-70.0	504	8400	2100	4
	MAX	-80	531	8850	2950	3
5	MIN	-50.0	450	7500	1250	6
	MEDIA	-120.0	600	10000	2500	4
	MAX	-110	630	10500	3500	3
6	MIN	-60.0	485	8085	1617	5
	MEDIA	-130.0	582	9699	3233	3
	MAX	-135	726	12099	4033	3
7	MIN	-70	580	9665	1933	5
	MEDIA	-140	696	11601	3867	3
	MAX	-130	870	14499	4833	3


simianproject.com

SCHEDA TECNICA PRODOTTO		DATA/DATE 10/09/2016	
AMPLIFICATORE D.30		AUTORE/AUTHOR L.Lombardi	
		PESO/WEIGHT 0.000 kg	SCALA/SCALE 1:1
		CODICE/CODE 90AM30ES-S	REV. 00